

DOOR AND WINDOW SCHEDULE

D1-D2 3000MM HIGH FACE SLIDER, MIN. CLEAR OPENING DISTANCE OF 850MM.
ALUMINIUM FRAMES POWDERCOATED BLACK. - CRITERION PLATINUM SUITE 120
OR SIMILAR AS APPROVED BY ARCHITECT.

D3 920MM X 2400MM ALUMINIUM FRAMED DOORS WITH TRANSPARENT GLASS
ALUMINIUM FRAMES POWDERCOATED BLACK - CRITERION PLATINUM SUITE 120
OR SIMILAR AS APPROVED BY ARCHITECT.

D4 3000MM HIGH CAVITY SLIDER, MIN. CLEAR OPENING DISTANCE OF 850MM.
ALUMINIUM FRAMES POWDERCOATED BLACK. - CRITERION PLATINUM SUITE 120
OR SIMILAR AS APPROVED BY ARCHITECT.

D5-D6 920MM X 2400MM TIMBER FRAMED SEMI-SOLID CORE DOOR WITH ALUMINIUM
STILES POWDER COATED BLACK

D7 2400MM HIGH CAVITY SLIDING DOOR, MIN. CLEAR OPENING 850MM,
SEMI-SOLID CORE WITH FLUSH PULL HANDLE

D8 920MM X 2040MM TIMBER FRAMED SOLID CORE ACCOUSTIC DOOR WITH
ACCOUSTIC SEALS

D9 920MM X 2040MM DOOR. REF TO RADIATION SHIELDING REPORT FOR SPECS

D10 920MM X 2400MM ALUMINIUM FRAMED DOORS WITH TRANSPARENT GLASS
NATURALLY ANODISED FRAMES - CRITERION PLATINUM SUITE 120
OR SIMILAR AS APPROVED BY ARCHITECT.

W1-W3 FULL HEIGHT ALUMINIUM FRAMED WINDOWS NATURALLY ANODISED WITH
TRANSPARENT GLASS

W4 ALUMINIUM FRAMED WINDOW NATURALLY ANODISED FROM 900MM AFFL - 1500MM AFFL
TRANSLUCENT GLASS

**NOTE: ALL DOORS TO HAVE LOCKS, ALL LOCKS TO BE KEYED ALIKE. ALL DOORS TO BE ALWAYS
OPERABLE IN PATH OF EGRESS. OPERABLE FORCE OF ALL ACCESSIBLE DOORS ARE NOT TO
EXCEED 20N. D-TYPE LEVER HANDLES TO BE INSTALLED ON DOORS AS PER AS1428.1. ALL DOORWAYS
SHALL HAVE A MINIMUM LUMINANCE CONTRAST OF 30% BETWEEN TWO OF: DOOR FACE / DOOR
ARCHITRAVE AND WALL.**

NEW FACADE FRONTING
INTO SHOPPING CENTRE.
REFER ELEVATION FOR
DETAILS.

PARTITIONS KEY


P1 13MM PB/90MM STEEL STUDS @ 450 CTRS/13MM PB WITH ACCOUSITC INSULATION

X BRACING FOR XRAY UNIT

 UNOBSSTRUCTED/CLEAR DDA CIRCULATION SPACE 1500MM X 1500MM

NOTE: COVED VINYL TO SURGERIES, STERI, LAB AND PLANT ROOM.
OTHER AREA SKIRTING IS 100MM FLAT BAR ALUMINIUM (COLOUR TBC)
ANY UNLABELLED PARTITIONS ASSUME TO BE TYPE P1.

NOTES: DECALS INSTALLED TO ALL INTERNAL GLAZING LOCATED BETWEEN 900MM AND 1000MM
ABOVE FINISHED FLOOR LEVEL. MIN 75MM BAND.
PROVIDE WATER RESISTANT SPLASHBACK TO A HEIGHT OF NOT LESS THAN 150MM ABOVE THE
VESSEL (SINKS) AND FOR THE EXTENT OF THE VESSEL (WHERE WITHIN 75MM OF A WALL) IN
TOILETS, KITCHEN AND LAB AREAS.

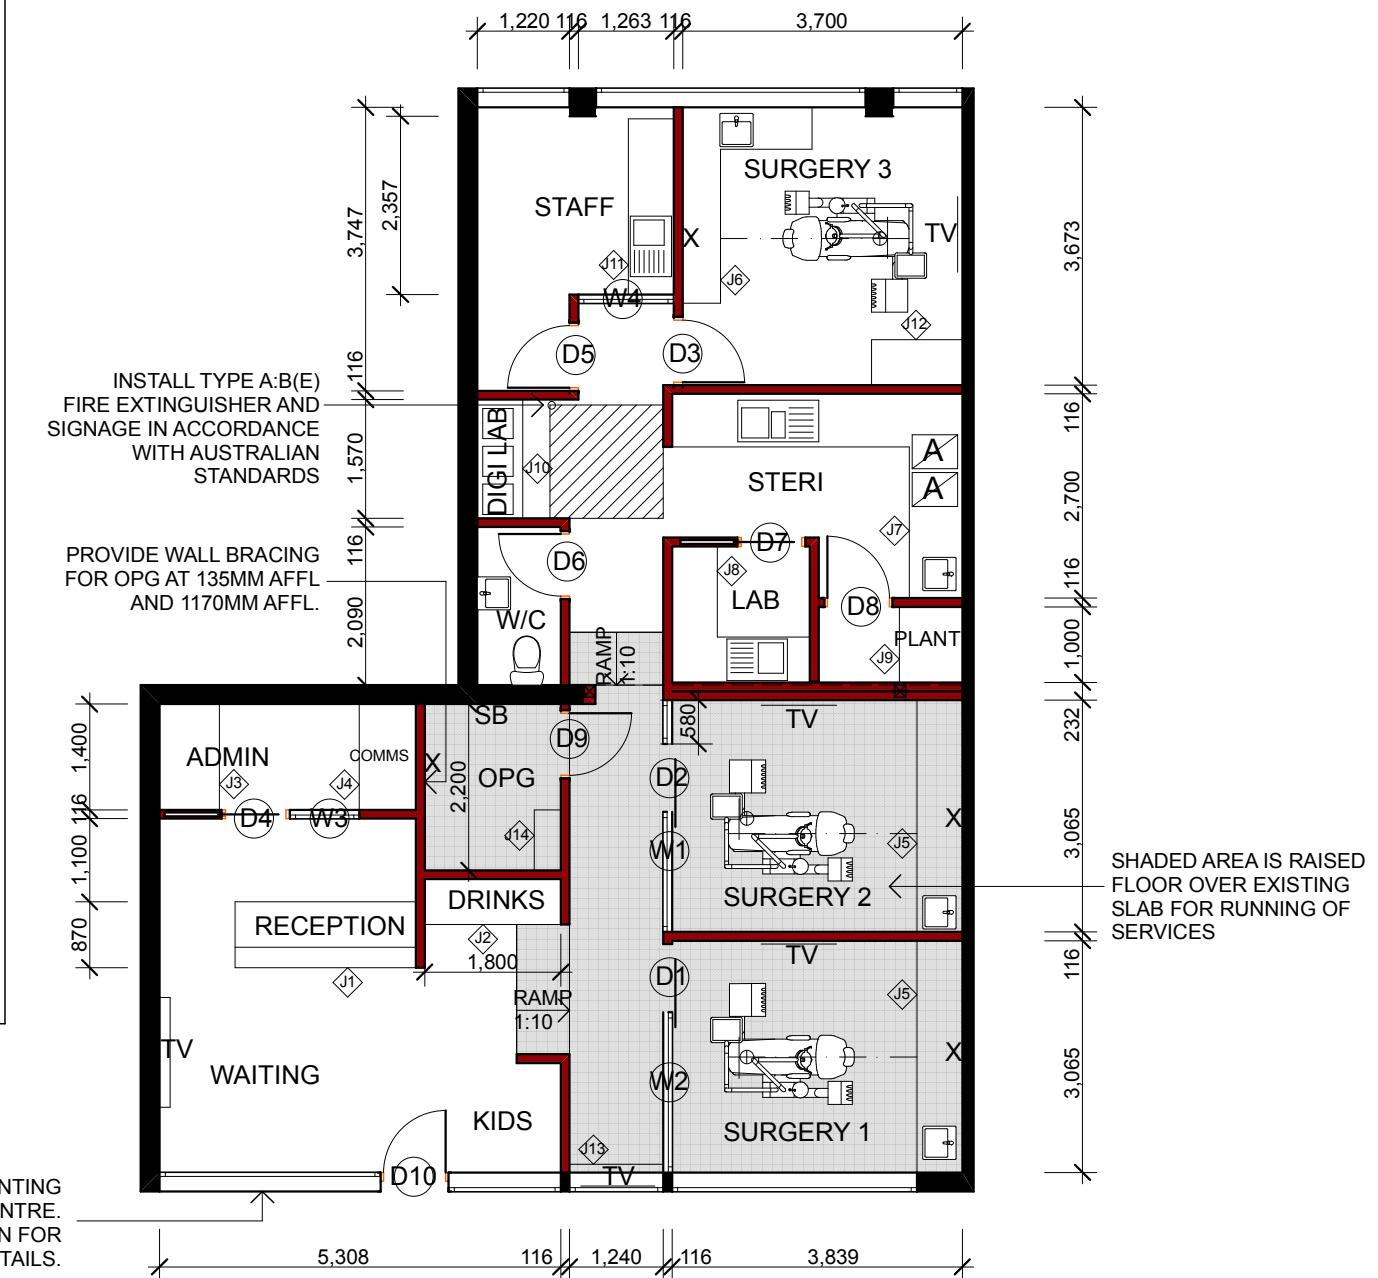

PARTITIONS AND DOORS - FLOOR PLAN

1:100 @ A3

N



CROYDON DENTAL - NAME TBC

CROYDON SHOPPING CENTRE
5-15 KENT AVE
CROYDON VIC 3136

PARTITIONS AND DOORS PLAN
SCALE 1:100 @ A3
DRAWING NUMBER: CD001 REV B